

Effects of Ferric Salt of Different Forms on Phosphorus Removal


Jingliang Xie^{1*}, Feifei Chi¹, Wang Qiang², and Anran Peng¹

¹School of Environmental and Municipal Engineering, Qingdao University of Technology, Qingdao 266033, China

²Qingdao Shuang Yuan Water Affairs Co., Ltd., Qingdao 266109, China

*to whom all correspondence should be addressed: e-mail: jingliangx@163.com

GRAPHICAL ABSTRACT

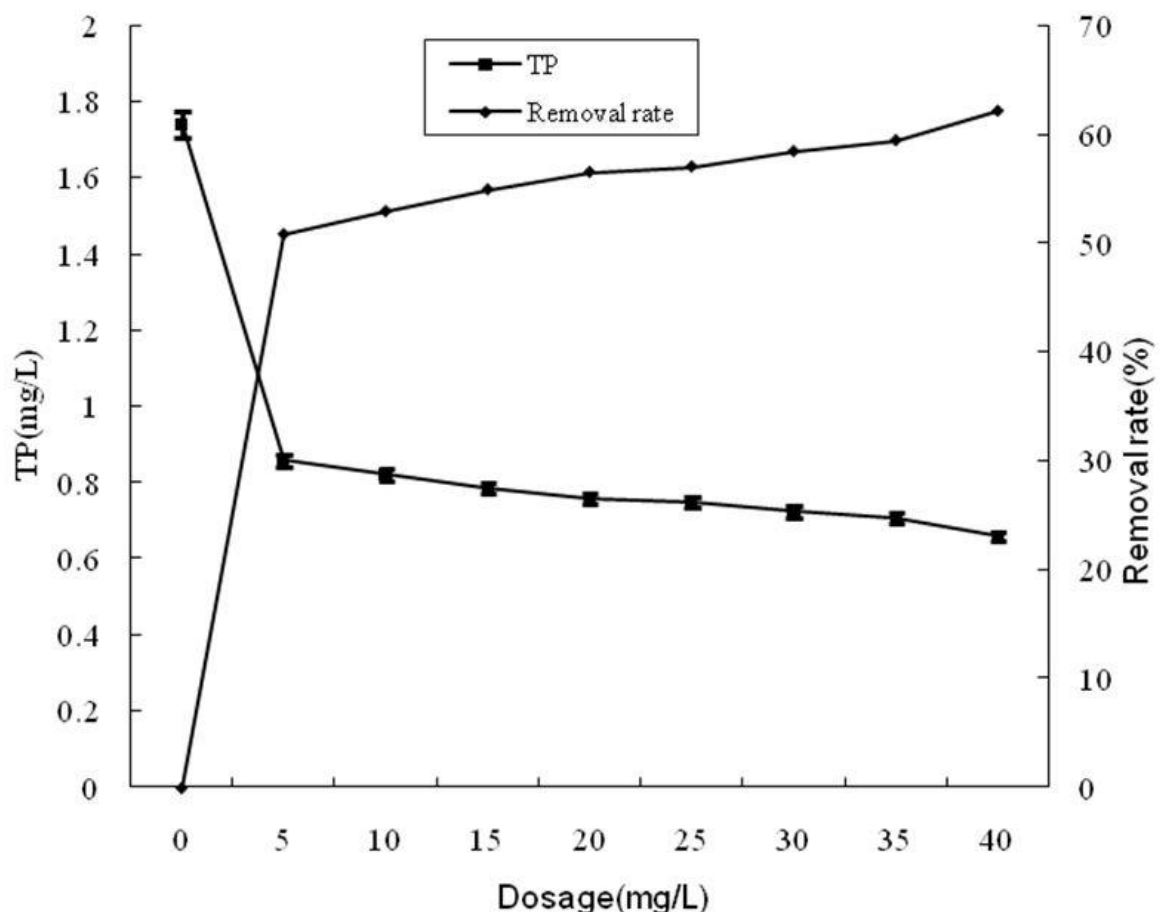

Abstract

This paper has studied phosphorus removal effects of ferric chloride (ionic state), polyferric chloride (polymer state) and ferric hydroxide (gel state) on the effluent of a municipal sewage treatment plant. The total phosphorus (TP) in the effluent was $1.74 \text{ mg}\cdot\text{L}^{-1}$. Results showed that ferric chloride was the best phosphorus remover among the three forms of ferric salt coagulants. With a dosage of $40 \text{ mg}\cdot\text{L}^{-1}$,

its phosphorus removal rate could reach 90% and TP in the treated wastewater was reduced to less than $0.17 \text{ mg}\cdot\text{L}^{-1}$. After the treatment, the effluent quality met the first level A criteria in the *Discharge Standard of Pollutants for Municipal Wastewater Treatment Plant* (GB18918-2002). At the same dosage of $40 \text{ mg}\cdot\text{L}^{-1}$, the phosphorus removal rates of polyferric chloride and ferric hydroxide were 62% and 59%, respectively, lower than the rate of ferric chloride.

Keywords: municipal wastewater, coagulant, ionic Fe, polymeric Fe, gel Fe, chemical phosphorus removal

1. Introduction

Large-scale *Enteromorpha* sp. green tides have broken out for several consecutive years in the Yellow Sea of China. This has exposed fragile ecosystems to an ever-increasing risk and affected the tourism of coastal cities. According to the enclosure experiment. (Wu Xiaowen et al., 2010; Zulkapli et al., 2018) in Qingdao offshore, rich nutrients in the estuary area and coastal waters are one of the preconditions for the large-scale propagation and outbreak of *enteromorpha prolifera*. Phosphorus is the primary limiting nutrient for algae production. The yield of algae can be increased when phosphorus is efficiently utilized from the growth medium (Wang and Peng, 2009). Therefore, controlling phosphorus discharged from municipal wastewater treatment plants is a key factor in preventing eutrophication of surface waters (Peng and Chen, 1988; Xiong et al., 2006; Luo et al., 2010; Wang et al., 2018; Zhang et al., 2019).

Phosphates can be removed from wastewater based on principles of both biology and chemistry. Biological phosphorus removal has poor stability and flexibility (Jin et al., 2002; Jian et al., 2008; Zhang and Peng, 2011), often depending on the quality of influent water and operating conditions, such as carbon source and pH value (Chen et al., 2004; Liu et al., 2007; Wang et al., 2017; Zhang et al., 2019). The phosphorus content of effluent treated by the biological method often fails to meet national emission standards. A/O, A²/O, Bardenpho and SBR are enhanced biological phosphorus removal processes. When such processes are used to treat municipal wastewater, the phosphorus removal rate could reach 75% (Tian, 1996; Deng and Guo, 2002; Niu, 2006). In other words, if the TP content of the inlet water is 4-8 mg/L, the TP content of the outlet water will be 1-2 mg/L, which means that the first level A criteria ($\text{TP} \leq 0.5 \text{ mg/L}$) in the *Discharge Standard of Pollutants for Municipal Wastewater Treatment Plant* (GB18918-2002) cannot be achieved. Therefore, it is recommended to adopt the chemical phosphorus removal method to improve stability and reach the effluent standard.

In practical engineering, sedimentation, synchronous sedimentation and post sedimentation or flocculation filtration after biological treatment are commonly used for chemical phosphorus removal. They are different in dosing location of the agent. Synchronous sedimentation has nearly 50% market share, because it does not involve much construction work and has very good settling properties of the sludge. However, in its application to a Qingdao sewage treatment plant, the ammonia nitrogen is not up to the standard because the free acid in ferric chloride reduces the alkalinity of sewage and thus affects the nitrification of sludge (Parfitt et al., 1975; Liu et al., 2003; Hosseini et al., 2019; Islam et al., 2020). The following measures can be considered to reduce the influence of free acid: 1. adding

alkali to ferric chloride solution to make polymeric ferric chloride; 2. adding alkali to ferric chloride solution to directly make ferric hydroxide; 3. adding ferric chloride to sewage before adding alkali to boost its alkalinity. It is known that various polymerization forms of aluminum chloride show good phosphorus removal effects (Kang and Yang, 2008; Yang et al., 2009; Liu et al., 2011; Yang et al., 2017). However, few reports focus on the phosphorus removal effects of ferric chloride in different polymerization forms.

This paper discussed the phosphorus removal effects of three different polymerization forms of ferric. It aims to provide practical guidance for the engineering application of ferric salts.

2. Materials and Methods

2.1. Materials and instruments

Experimental water: secondary effluent from a Qingdao sewage plant (TP 1.74 mg/L, COD_{cr} 45 mg/L, ammonia nitrogen 4.5 mg/L, alkalinity 65 mg/L).

Chemicals & Reagents: ferric chloride with analytical purity, and ferric chloride solution with concentration of 10%; alkali was added to 10% ferric chloride solution to prepare polyferric chloride (pH = 3.5); alkali was added to 10% ferric chloride solution to prepare ferric hydroxide (pH = 7).

Instruments: Shimadzu UV-mini1240 UV visible spectrophotometer, ZR4-6 mixer, and PHS-3CpH meter, etc.

2.2. Experimental methods

First, containers of the mixer were added equal amount of secondary effluent that flowed out of a sewage treatment plant. Second, ferric chloride, polymeric ferric chloride and ferric hydroxide, each with 9 gradients of dosages — 0 mg/L, 5 mg/L, 10 mg/L, 15 mg/L, 20 mg/L, 25 mg/L, 30 mg/L, 35 mg/L and 40 mg/L (all calculated by ferric chloride) — were put into their respective containers,.

The coagulation and mixing parameters of the six-joint stirrer were set as follows: 1) rapid mixing for 30 s with speed of 250 r/min; 2) slow mixing for 10 min with speed of 120 r/min; 3) After standing sedimentation for 30 min, the supernatant was taken to determine the TP.

3. Results and Analysis

3.1. Phosphorus removal effects of ionic Fe (ferric chloride)

Figure 1 shows the TP removal effect of ionic Fe in the secondary effluent when its dosage was 0 mg/L, 5 mg/L, 10 mg/L, 15 mg/L, 20 mg/L, 25 mg/L, 30 mg/L, 35 mg/L and 40 mg/L.

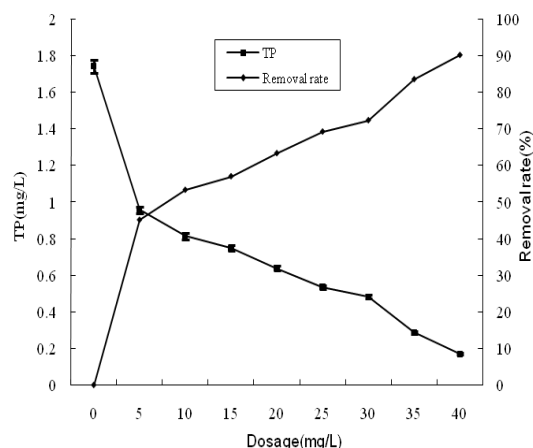


Figure 1. The TP removal effect of ferric chloride with dosages in the secondary effluent

According to **Figure 1**, as the dosage of ionic FeCl_3 increased, the TP removal rate in the secondary effluent gradually went up. The dosage had a linear correlation with the TP removal rate, with a slope of approximately 0.36. When the dosage of ionic Fe increased to 40 mg/L, the removal rate of TP grew to 90%, and the TP concentration decreased from 1.74 mg/L to 0.17 mg/L. After the treatment, TP concentration in the supernatant reached the first level A criteria ($\text{TP} \leq 0.5$ mg/L) in the *Discharge Standard of Pollutants for Municipal Wastewater Treatment Plant* (GB18918-2002). The additions of ionic Fe kept reducing TP concentration in the supernatant and the declining trend continued.

2.2. Phosphorus removal effect of polymeric Fe (polyferric chloride)

Polymeric Fe was added to the secondary effluent. Its removal effect on TP in secondary effluent is shown in **Figure 2**. The dosages were 0 mg/L, 5 mg/L, 10 mg/L, 15 mg/L, 20 mg/L, 25 mg/L, 30 mg/L, 35 mg/L and 40 mg/L.

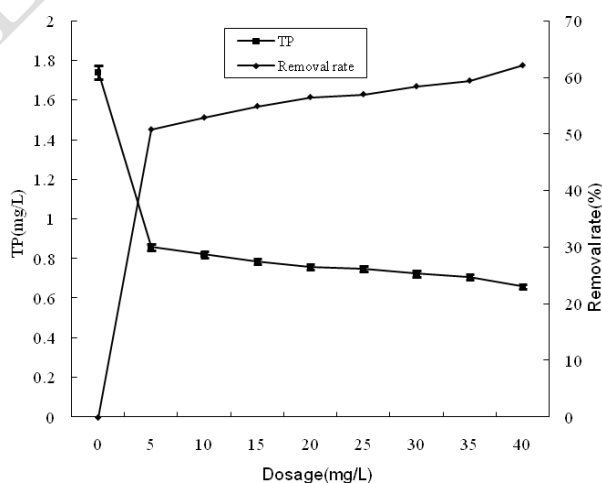


Figure 2. The effect of polyferric chloride dosage on TP removal of secondary effluent

According to **Figure 2**, polymeric Fe showed similar TP removal rate as ionic Fe. As its dosage increased in secondary effluent, the removal rate gradually grew. The difference was that polymeric Fe only had a little improvement of TP removal rate, from 50% to 62%, when its dosage increased from 5 mg/L to 40 mg/L. The TP concentration decreased from 1.74 mg/L to 0.66 mg/L. The TP concentration in the polymeric Fe-treated supernatant did not reach the first level A criteria ($TP \leq 0.5$ mg/L) in the *Discharge Standard of Pollutants for Municipal Wastewater Treatment Plant* (GB18918-2002). Moreover, compared with the phosphorus removal pattern of ionic Fe, polymeric Fe reduced TP concentration in a relatively gentle way. Its amount in the supernatant had a downward linear correlation with TP concentration, but the slope was only about 0.14. This indicated that ionic Fe was better at removing phosphorus than polymerized $FeCl_3$.

2.3. Phosphorus removal effect of gel Fe (ferric hydroxide)

Figure 3 shows the TP removal effect of gel Fe in the secondary effluent, with dosages of 0 mg/L, 5 mg/L, 10 mg/L, 15 mg/L, 20 mg/L, 25 mg/L, 30 mg/L, 35 mg/L and 40 mg/L.

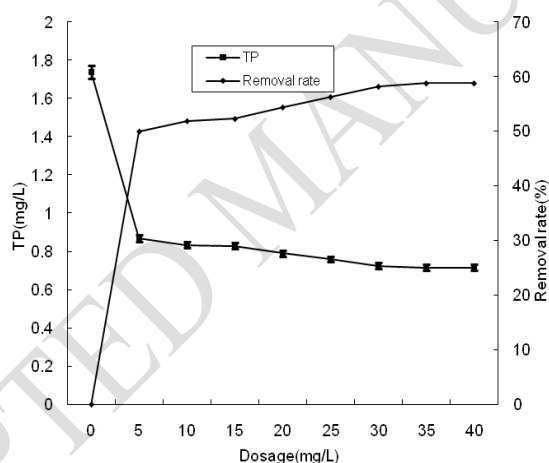


Figure 3. The effect of different dosages of ferric hydroxide on TP removal in the secondary effluent

According to **Figure 3**, gel Fe had similar phosphorus removal pattern as polymeric Fe. As the dosage of gel Fe increased, the TP removal rate in secondary effluent went up slowly. The difference was that when the dosage of gel Fe increased from 5 mg/L to 40 mg/L, the TP removal rate grew from 50% to 59%, and the TP concentration slightly dropped from 1.74 mg/L to 0.72 mg/L. Thus, gel Fe had relatively lower ability to remove phosphorus than polymeric Fe. Its linear slope of correlation between dosage and removal rate was about 0.12. The TP concentration in the supernatant treated by gel Fe failed to meet the level A criteria in the *Discharge Standard of Pollutants for Municipal Wastewater Treatment Plant* (GB18918-2002).

Based on our analysis and comparison, all forms of ferric salt, including ionic Fe, polymeric Fe and gel Fe, have the ability to effectively remove phosphorus, but with different removal rates. To be specific, ionic Fe had the best effect on phosphorus removal. Its removal rate was 17% and 22%

higher than those of polymeric Fe and gel Fe. Polymeric Fe was better at removing phosphorus than gel Fe, but its removal rate was only 5% higher (Haroon et al., 2018; Ogunele et al. 2018). This indicates that TP removal is mainly caused by ionic reaction of ferric salt coagulant and supplemented by polymeric adsorption. The degree of polymerization, or DP, has little effect on the removal process.

4. Conclusions

(1) When ionic Fe, polymeric Fe and gel Fe were used to remove phosphorus from the secondary effluent, all their TP removal rates increased with dosages. Among them, ionic Fe showed the best effect. When three 40 mg/L dosages of ionic Fe, polymeric Fe and gel Fe were added into the secondary effluent, the phosphorus removal rates were 90%, 62% and 59%, respectively. However, under such dosage, only ionic Fe could have higher than A-level performance that met the criteria of the *Discharge Standard of Pollutants for Municipal Wastewater Treatment Plant* (GB18918-2002). The other two forms of ferric salt failed to achieve the standard.

(2) When ferric salt dissolves in water, Fe ion will undergo hydrolysis and polymerization process, changing from ionic state to various hydroxyl complex forms. When the ionic Fe is added to the sewage, it reacts with the dissolved phosphate when hydrolyzed. This reaction plays an important role in phosphorus removal process, as can be shown in the experimental results. When polymeric Fe or gel Fe are added to the sewage, they mainly remove gel PO_4^{3-} by charge neutralization, adsorption bridging and floc scrolling. As these processes have relatively modest removal effect, they play a supplementary role in phosphorus removal.

(3) In practice, phosphorus removal projects should choose ionic Fe as adsorbent for phosphate removal. However, as ionic Fe is a strong acid ($\text{pH} < 1$), it will consume a certain alkalinity during phosphorus removal. Therefore, when the ionic Fe is used in the wastewater treatment plant to remove phosphorus from the influent, alkalinity should be appropriately added to facilitate nitrification in the subsequent biological denitrification to guarantee the effects of biological denitrification.

(4) The experiment also shows that polymeric Fe and gel Fe at low dosage has better removal efficiency than ionic Fe. This is caused by two forms of phosphorus in the sewage — dissolved phosphorus and fine insoluble phosphorus. When dosages are kept low, ionic Fe can only react with dissolved phosphorus to form fine and insoluble ferric phosphate, which has poor settling ability. By contrast, polymeric Fe and gel Fe have better efficiency in phosphorus flocculation and sedimentation, for existing small and insoluble ones in particular (Youdeowei et al., 2019; Asadullah et al., 2018; Amina and Kamel, 2019). Therefore, low dosages of polymeric Fe and gel Fe greatly contribute to phosphorus removal and the reasons are yet to be studied and verified.

References

- Amina A, Kamel K (2019). Water Quality of The Kebir Watershed, Northeast of Algeria. *Journal Clean Was*, **3**, 28-32.
- Asadullah N, Faizan A, Farva K (2018). Evaluation of Low Cost Environment Friendly Natural

Extracts For The Purification Of Drinking Water. *Earth Sciences Pakistan*, **2**, 23-25.

Chen YG, Randall AA, McCue T. (2004). The Efficiency of Enhanced Biological Phosphorus Removal from Real Wastewater Affected by Different Ratio of Acetic to Propionic Acid. *Water Research*, **38**, 27-36

Deng RS, Guo J. (2002). A Study on Mechanism of Biological Denitrification and Phosphorus Removal for Urban Wastewater. *Journal of Chongqing Jianshu University*, **24**, 106-111

Haroon R, Arslan C, Shahbaz NK (2018). Wastewater Irrigation, Its Impact On Environment And Health Risk Assessment In Peri Urban Areas Of Punjab Pakistan – A Review. *Environmental Contaminants Reviews*, **1**, 30-35.

Hosseini S. A. & Sharifi F. (2019) Improvement stability of earth canal banks using geo-technical approaches, *Geology, Ecology, and Landscapes*, **3**, 308-317, DOI: 10.1080/24749508.2018.1563751.

Hu ZY, Ouyang X. (2006). Studies on Removal of N and P in Eutrophic Water Bodies. *China Municipal Engineering*, **123**, 39-41

Islam M.A., Islam S.M.A., Sathi M.A. (2020). Identification Of Lentil Varieties/Lines Resistant To Stemphylium Blight Considering Disease Reaction And Yield. *Malaysian Journal of Sustainable Agriculture*, **4**, 22-25.

Jian FL, Yang XS, Liang JJ. (2008). Phosphorus Removal from Municipal Wastewater with Filter Materials. *Ecology and Environment*, **17**, 55-58

Jin XB, Yu YM, Zhang YF. (2002). Comparison between Biological and Chemical Phosphorus Removal. *Journal of Shanghai Teachers University (Natural Sciences)*, **31**, 78-82

Kang XD, Yang K. (2008). The Comparative Test of Chemical Phosphorous Removal Agent. *Shanxi Architecture*, **34**, 194-195

Liu HL, Zhao X, Jiao RY, et al. (2011). Effects of Polymer Aluminum Hydrolysis on Phosphorus Distribution in Coagulation. *Environmental Science*, **32**, 102-107

Liu Y, Chen YG, Zhou Q, et al. (2007). Effect of Initial pH Control on Biological Phosphorus Removal from Wastewater Containing Acetic and Propionic Acids. *Chemosphere*, **66**, 123-129

Liu ZP, Lu SM, Li S. (2003). The Study on Iron Salt Synchronization Dephosphorization. Techniques and Equipment for Environmental. *Pollution Control*, **4**, 16-18

Luo B, Liu SQ, Jiang ZM. (2010). Study Progress of Domestic Sewage Dephosphorization Technics. *Journal of Anhui Agricultural Sciences*, **38**, 4769-4771, 4774

Niu YH. (2006). Analysis of Advantages and Disadvantages of Dephosphorization Methods in Wastewater Treatment. *Hebei Journal of Industrial Science and Technology*, **358**, 356-359

Ogunyele, A. C., Obaje, S. O., Akingboye, A. S. (2018). Lithostructural Relationships and

- Petrogenetic Affinities of the Basement Complex Rocks around Okpella, Southwestern Nigeria. *Earth Sciences Malaysia*, **2**, 29-36.
- Parfitt RL, Atkinson RJ, Smart R St. C. (1975). The Mechanism of Phosphate Fixation by Iron Oxides. *Soil Science Society of America Journal*, **39**, 837-841
- Peng JX, Chen HJ. (1988). Nutrient Runoffs and Prevention. Beijing, *China Environmental Science Press*.
- Tian SY. (1996). The Effects of Short Chain Fatty Acid on Biological Phosphate Release and PHB Synthesis under Anaerobic Condition. *Transactions of Tianjin University*, **2**, 87-91
- Wang H, An X, Zhang Z. (2018). Effect of Advanced Treatment on Ammonia Nitrogen Contained in Secondary Effluent from Wastewater Treatment Plant. *Fresenius Environmental Bulletin*, **27**, 2043-2050
- Wang K, Li L, Xue W, et al. (2017). Electrodeposition Synthesis of PANI/mnO₂/graphene Composite Materials and Its Electrochemical Performance. *International Journal of Electrochemical Science*, **12**, 8306-8314
- Wang XL, Peng YZ. (2009). A²/O Method Wastewater Biological Nitrogen Phosphorus. Processing Technology and Application. *Science Press*.
- Wu XW, Li RX, Xu ZJ, et al. (2010). Mesocosm Experiments of Nutrient Effects on Enteromorpha prolifera Growth. *Advances in Marine Science*, **10**, 538-544.
- Xiong GX, Luo JZ, Feng AK. (2006). The Removal of Phosphorus From Wastewater and the Research Trends. *Industrial Safety and Environmental Protection*, **32**, 19-21
- Yang A, Han Y, Li S, et al. (2017). Synthesis and Comparison of Photocatalytic Properties for bi₂wo₆ Nanofibers and Hierarchical Microspheres. *Journal of Alloys and Compounds*, **695**, 915-921
- Yang YL, Li X, Fan Q. (2009). Preparation of Iron-Aluminum Compositated Adsorbent and the Removal Trace Phosphorus. *Transactions of Beijing Institute of Technology*, **29**, 73-75
- Youdeowei, P.O; Nwankwoala, H.O, Desai, D.D (2019). Dam Structures And Types In Nigeria: Sustainability And Effectiveness. *Water Conservation and Management*, **3**, 20-26.
- Zhang JQ, Peng YZ. (2011). Effect of COD on Enhanced Biological Phosphorus Removal System and Variation of OUR. *Chinese Journal of Environmental Engineering*, **5**, 301-305
- Zhang L, Chen J, Zhang L, et al. (2019). Preparation of Soybean Oil Factory Sludge Catalyst and Its Application in Selective Catalytic Oxidation Denitration Process. *Journal of Cleaner Production*, **225**, 220-226
- Zhang L, Jia Y, Zhang L, et al. (2019). Preparation of Soybean Oil Factory Sludge Catalyst by Plasma and the Kinetics of Selective Catalytic Oxidation Denitrification Reaction. *Journal of Cleaner Production*, **217**, 317-323

Zulkapli M. F., Rashid N. M., M S Mohd Nazri, N Noorshawal (2018). Study on Optical Properties of Graphene-TiO₂ Nanocomposite as Photoanodes Layer In Dye Sensitized Solar Cell (DSSC). *Environment & Ecosystem Science*, **2**, 39-41.

ACCEPTED MANUSCRIPT